




# Installation

## Water treatment system

Polyethylene mini grease separator

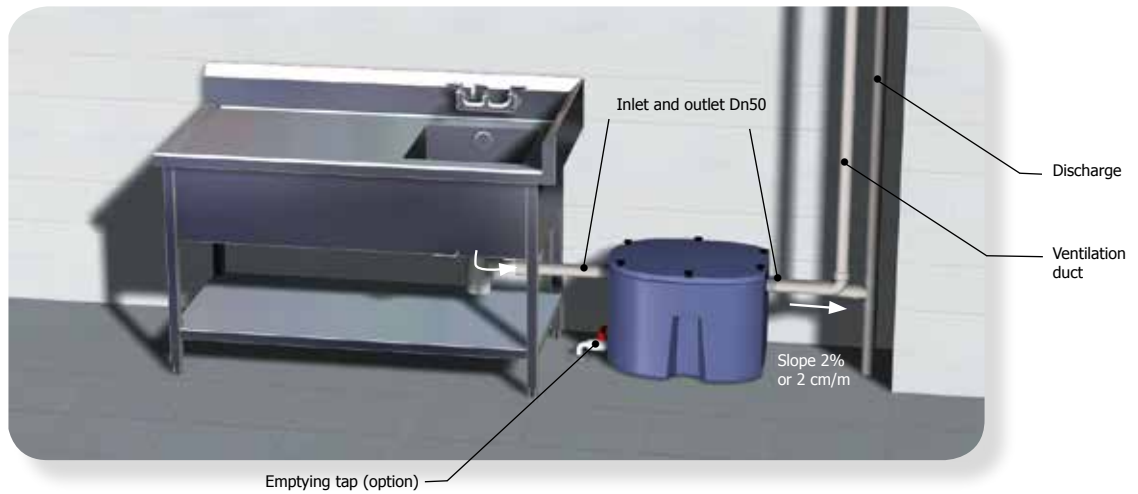

**Installation instructions delivered with the system remain reference instructions.**

### Installation procedure:

- 1 • GM1E is a grease separator for kitchen sink. It shall be installed out of the food preparation area. .
- 2 • GM1E is designed for the treatment of wastewater proceeding from one standard sink only.
- 3 • Install the GM1E close to the sink, the pipework slope must equal or exceed 2 cm/m. Respect the connection nominal diameter : Dn33/42.
- 4 • The discharge pipework must be as vertical as possible (avoid losses of hydraulic loads)
- 5 • Connect the ventilation duct.

### Maintenance procedure (when not in use):

- 1 • Clean the separator weekly : remove the cover and skim the grease layer from the water surface. Replace the cover.
- 2 • Clean the separator monthly:
  - Remove the cover (then connect the emptying valve using a pipe\*),
  - Skim the grease layer from the water surface. ,
  - Empty the GM1E separator (in the floor drain using the emptying valve\*),
  - Remove the reduction piece at the inlet of the separator ( held in place by a screw),
  - Clean the reduction piece with warm water then put it back in place (turn off the emptying tap \*),
  - Fill up the GM1E with water to the point of overflowing, put the cover back in place (remove the pipe connected to the emptying valve).

\*If the emptying tap is supplied (option).